

# Data Sheet

2018 v1.0

## SMART X835 Panel Mounted Multi-function Power Meter

- Suitable for Single & Three Phase networks
- Import / Export kWh
- UK CE Certification
- Backlit Digital Screen
- Pulsed Output
- RS485 Modbus RTU



## SMART X835 Multifunction Power Meter

The SMART X835 is a new generation modern design power monitor that will measure and display electrical power quality parameters. It has been engineered to cover most applications (Single Phase and Three Phase networks / Built in Pulse or RS485 Modbus outputs / Import and Export kWh) replacing the need for several different models of this power meter.

The 96mm<sup>2</sup> panel meter is produced to the highest quality and utilizes the latest microprocessor and technology. It has a blue backlit display and a total of 37 different measuring parameters. This includes a negative power reading to indicate reversal of CT installation or connection. With built in pulsed outputs and RS485 Modbus RTU it is fully compatible for integration with BMS and remote monitoring systems.

## Parameters

- Phase to Neutral Voltage (V)
- Reactive Power (kVAr)
- Apparent Power (kVA)
- Phase Current (A)
- Import Active Energy (kWh)
- Voltage Total Harmonic Distortion (U%THD)
- Export Active Energy (kWh)
- Current Total Harmonic Distortion (I%THD)
- Frequency (Hz)
- Total Active Energy (kWh)
- Power Factor (PF)
- Import Reactive Energy (kVArh)
- Current Max Demand (MD A)
- Export Reactive Energy (kVArh)
- Power Max Demand (MD kW)
- Total Reactive Energy (kVArh)
- Active Power (kW)

# Specifications

## Measured Parameters

The unit can monitor and display the following parameters of a single phase two wire (1p2w), three phase three wire (3p3w) or three phase four wire (3p4w) system.

## Voltage and Current

Each successive click of the UI button will show:

- Phase to neutral voltages 100 to 289V a.c.
- Phase to phase voltages 173 to 500V a.c.
- Current on each phase
- Current THD% for each phase

Hold down the M button, then each successive click of the UI button will show:

- Average demand voltage (Demand)
- Average demand current (Demand)
- Max demand voltage within the DIT (MAX Demand)
- Max demand current within the DIT (MAX Demand)
- Max peak voltage (MAX)
- Max peak current (MAX)

After holding down the M button, clicking the M button will show:

- Voltage phase sequence component
- Current phase sequence component

## Power factor and Frequency and Max. Demand

- Frequency in Hz
- Instantaneous power:
- Power 0 to 3600 MW
- Reactive power 0 to 3600 MVAR
- Volt-amps 0 to 3600 MVA
- Maximum demanded power since last Demand reset Power factor
- Maximum neutral demand current, since the last Demand reset (for three phase supplies only)
- Power factor (total)
- Power factor on each phase
- Max peak power factor (total)
- Max peak frequency
- Min peak power factor (total)
- Min peak frequency
- Average demand power
- Min demand power within the DIT
- Max demand power within the DIT
- Min power
- Max peak power

## Energy Measurements

|                                   |                      |
|-----------------------------------|----------------------|
| Imported/Exported active energy   | 0 to 9999999.9 kWh   |
| Imported/Exported reactive energy | 0 to 9999999.9 kVArh |
| Total active energy               | 0 to 9999999.9 kWh   |
| Total reactive energy             | 0 to 9999999.9 kVArh |

## Measured Inputs

Voltage inputs through 4-way fixed connector with 2.5mm<sup>2</sup> stranded wire capacity, single phase two wire(1p2w) or three phase four wire(3p4w) unbalanced. Line frequency measured from L1 voltage or L3 voltage. Three current inputs (six physical terminals) with 2.5mm<sup>2</sup> stranded wire capacity for connection of external CTs. Nominal rated input current 5A or 1A a.c. Rms.

|                              |  |
|------------------------------|--|
| Nominal Voltage Input        | (Ph+N) 100 to 289V (Ph+Ph) 173 to-500V |
| Max Continuous Voltage       | 120% of nominal                        |
| Nominal Input Current        | 0.25-5A(6)A AC rms                     |
| Max Continuous Current       | 120% of nominal                        |
| Nominal Input Current Burden | 0.5VA                                  |
| Frequency                    | 45-65Hz                                |

## Accuracy

|                             |  |
|-----------------------------|--|
| Voltage                     | 0.5% of range maximum                            |
| Current                     | 0.5% of nominal                                  |
| Frequency                   | 0.2% of mid-frequency                            |
| Power factor                | 1% of unity (0.01)                               |
| Active power (W)            | ±1% of range maximum                             |
| Reactive power (VAr)        | ±1% of range maximum                             |
| Apparent power (VA)         | ±1% of range maximum                             |
| Active energy (Wh)          | Class 1 IEC 62053-21                             |
| Reactive energy (VArh)      | ±1% of range maximum                             |
| Total harmonic distortion   | 1% up to 31st harmonic                           |
| Response time to step input | 1s, typical, to >99% of final reading, at 50 Hz. |

## Auxiliary Supply

The unit is powered by a 230V.a.c supply with neutral.

## Interfaces for External Monitoring

Three interfaces are provided:

- RS485 communication channel that can be programmed for Modbus RTU protocol
- Relay output indicating real-time measured energy.(configurable)
- Pulse output 3200imp/kWh (not configurable)

The Modbus configuration (baud rate etc.) and the pulse relay output assignments (kW/kVArh, import/export etc.) are configured through the set-up screens.

## Pulse Output

Opto-coupler with potential free SPST-NO Contact (Contact range 5-27VDC / Max current input: Imin 2mA and Imax 27mA DC).  
The pulse output can be set to generate pulses to represent kWh or kVArh.

Rate can be set to generate 1 pulse per:

0.01 = 10 Wh/VArh  
0.1 = 100 Wh/VArh  
1 = 1 kWh/kVArh  
10 = 10 kWh/kVArh  
100 = 100 kWh/kVArh

Pulse width 200/100/60 ms.

## RS485 Output for Modbus RTU

For Modbus RTU, the following RS485 communication parameters can be configured from the set-up menu:

Baud rate 2400, 4800, 9600, 19200, 38400

Parity none (default) / odd / even

Stop bits 1 or 2

RS485 network address 3-digit number, 1 to 247

Modbus™ Word order Hi/Lo byte order is set automatically to normal or reverse. It cannot be configured from the set-up menu.

## Reference Conditions of Influence Quantities

Influence Quantities are variables that affect measurement errors to a minor degree. Accuracy is verified under nominal value (within the specified tolerance) of these conditions.


|                                   |                                       |
|-----------------------------------|---------------------------------------|
| Ambient temperature               | 23°C ±1°C                             |
| Input waveform                    | 50 or 60Hz ±2%                        |
| Input waveform                    | Sinusoidal (distortion factor < 0.05) |
| Auxiliary supply voltage          | Nominal ±1%                           |
| Auxiliary supply frequency        | Nominal ±1%                           |
| Auxiliary supply waveform (if AC) | Sinusoidal (distortion factor < 0.05) |
| Magnetic field of external origin | Terrestrial flux                      |

## Environment


|                       |                          |
|-----------------------|--------------------------|
| Operating temperature | -25°C to +55°C*          |
| Storage temperature   | -40°C to +70°C*          |
| Relative humidity     | 0 to 95%, non-condensing |
| Altitude              | Up to 3000m              |

## Wiring Diagrams


Single Phase Two Wire

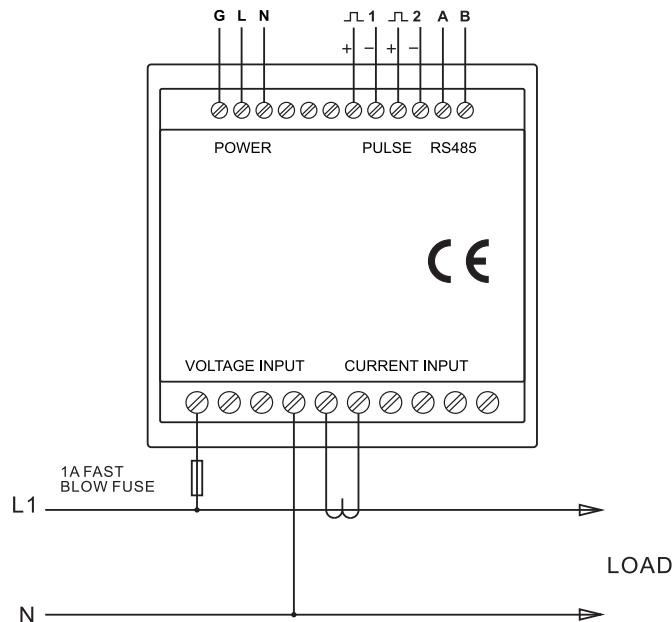

Three Phase Three Wire

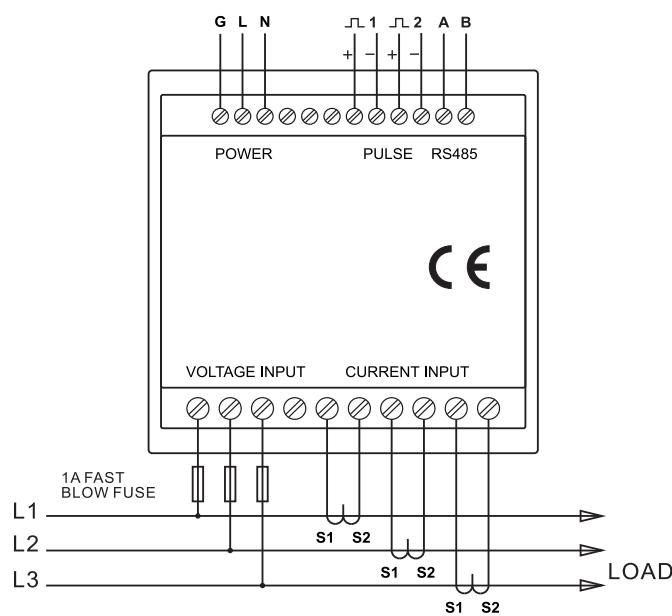

Three Phase Four Wire

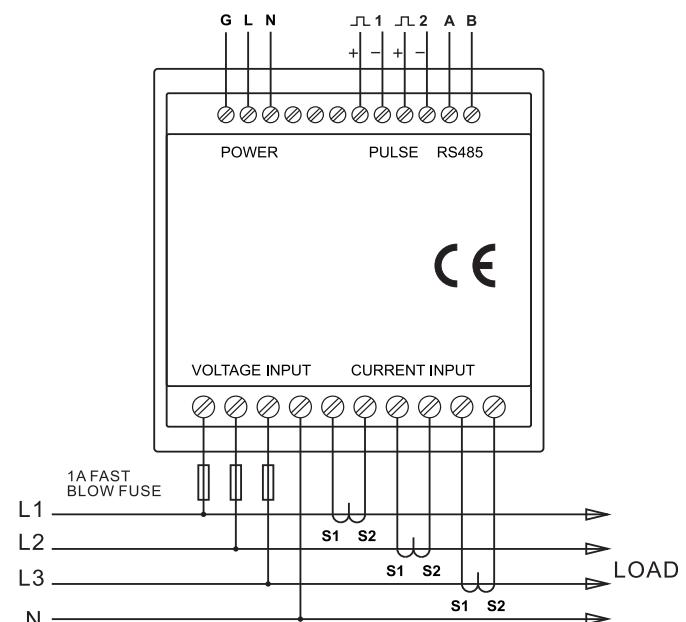

Specification subject to change without notification.